



FLEXIBLE CONNECTIONS IN HIGH PRESSURE GAS SYSTEMS

Doc 42/16

Revision of Doc 42/04

EUROPEAN INDUSTRIAL GASES ASSOCIATION AISBL

AVENUE DES ARTS 3-5 • B-1210 BRUSSELS
Tel: +32 2 217 70 98 • Fax: +32 2 219 85 14
E-mail: info@eiga.eu • Internet: www.eiga.eu



FLEXIBLE CONNECTIONS IN HIGH PRESSURE GAS SYSTEMS

Prepared by EIGA WG-2 Gas Cylinders and Accessories

Disclaimer

All technical publications of EIGA or under EIGA's name, including Codes of practice, Safety procedures and any other technical information contained in such publications were obtained from sources believed to be reliable and are based on technical information and experience currently available from members of EIGA and others at the date of their issuance.

While EIGA recommends reference to or use of its publications by its members, such reference to or use of EIGA's publications by its members or third parties are purely voluntary and not binding.

Therefore, EIGA or its members make no guarantee of the results and assume no liability or responsibility in connection with the reference to or use of information or suggestions contained in EIGA's publications.

EIGA has no control whatsoever as regards, performance or non performance, misinterpretation, proper or improper use of any information or suggestions contained in EIGA's publications by any person or entity (including EIGA members) and EIGA expressly disclaims any liability in connection thereto.

EIGA's publications are subject to periodic review and users are cautioned to obtain the latest edition.



Table of Contents

1	Introduction	1
2	Scope and purpose	1
2.1	Scope	1
2.2	Purpose	1
3	Definitions	1
3.1	Publication terminology	1
4	Flexible connections	2
4.1	General	2
4.2	Flexible hoses	2
4.3	Pigtails	2
4.4	Articulated / swivel joints	3
5	Failures of flexible connections	3
5.1	Poor design and/or manufacture	4
5.2	Material compatibility	4
5.3	Contamination	5
5.4	Rapid pressurisation, (adiabatic compression) and depressurisation	5
5.5	Particles	6
5.6	Misuse, damage and poor maintenance	7
6	Recommendations for the prevention of failures of flexible connections	7
6.1	Design specification and manufacturing control	7
6.2	Material compatibility	9
6.3	Cleanliness	9
6.4	Rapid pressurisation (Adiabatic compression)	9
6.5	Particles	10
6.6	Static electricity	11
6.7	Operation, use and maintenance	11
7	Check list	11
8	References	11
	Appendix 1 - Adiabatic compression	13
	Appendix 2 - Check list	14
	Appendix 3 - Example of a hose with a bent and straight distance piece	15

Figures

Figure 1	Construction of a typical hose with a PTFE (polytetrafluorethylene) liner	2
Figure 2	Pigtails used for an installation of bundles of cylinders	3
Figure 3	Swivel joint	3
Figure 4	Manifold layout	6

Tables

Table 1	Auto ignition temperatures of some common plastic/elastomeric materials in oxygen at 130 bar	4
---------	--	---

Amendments from 42/04

Section	Change
	Rewrite to reflect current hose philosophy

1 Introduction

Since the publication of the original document in 1986, IGC 42, *Prevention of Hose Failures in High Pressure Gas Systems* [1]¹, there has been progress in the development of International Standards, such as EN ISO 14113, *Gas welding equipment. Rubber and plastics hose and hose assemblies for use with industrial gases up to 450 bar (45 MPa)* relating to hoses for high-pressure gas systems. In addition to this, EIGA member companies have reported a significant improvement in hose performance, and this has been reflected in EIGA safety statistics.

The intention of updating the original document in 2004 was to extend the scope to include other types of flexible connections, for example joints and to include the operational experience gained since publication of the original document.

In 2015, a new ISO standard was published, ISO 16964, *Gas cylinders - Flexible hose assemblies - Specification and testing* [3]. Its scope covers hose assemblies intended to be connected to gas cylinders, bundles of cylinders or trailers for use when filling and emptying gas at production sites and also for customer use. The standard applies to flexible hose assemblies with rated pressures up to 1 000 bar for use in the temperature range of -40° C to +65° C.

This publication has been revised to reflect current standards.

2 Scope and purpose

2.1 Scope

This publication includes flexible connections for charging and discharging, compressed, liquefied and dissolved gases in the temperature range -40 °C to + 65 °C. There are no upper or lower pressure limits.

Flexible connections for cryogenic fluids are excluded which are covered by EN 12434, *Cryogenic vessels - Cryogenic flexible hoses* [4].

2.2 Purpose

This publication provides guidance on the design of systems that use flexible connections for high-pressure gas, such that the integrity of systems using these components is further improved.

3 Definitions

3.1 Publication terminology

3.1.1 Shall

Indicates that the procedure is mandatory. It is used wherever the criterion for conformance to specific recommendations allows no deviation.

3.1.2 Should

Indicates that a procedure is recommended.

3.1.3 May

Indicates that the procedure is optional.

¹References are shown by bracketed numbers and are listed in order of appearance in the reference section.

3.1.4 Will

Used only to indicate the future, not a degree of requirement.

3.1.5 Can

Indicates a possibility or ability.

4 Flexible connections

4.1 General

Flexible connections are used extensively in the industrial gases industry for a variety of applications for the transmission of gases. They can be classified into the following types:

- Flexible hoses;
- Pigtails; and
- Articulated joints.

For the purpose of this publication, a flexible connection is the generic term covering any of the above connection types.

4.2 Flexible hoses

Flexible hoses are the most widely used type of flexible connections, and these can be divided into two groups:

- Hoses incorporating a plastic liner with metal or filament over braiding, see Figure 1; and
- Hoses incorporating a corrugated metallic liner with over braiding.

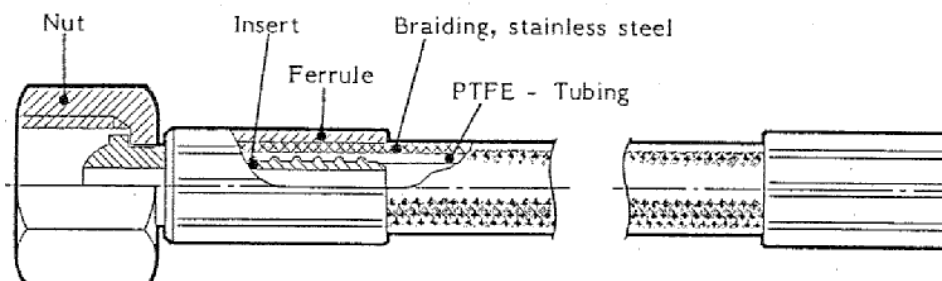


Figure 1 Construction of a typical hose with a PTFE (polytetrafluorethylene) liner

PTFE lined hoses have been used successfully in high-pressure gas systems for many years. However, hose failures, in particular ignition of the hose liner when used in oxygen service, have been reported from time to time.

Although most of the reported failures are associated with distribution manifold systems, typically at customer installations, failures have also been reported at cylinder filling stations.

4.3 Pigtails

Pigtails are usually manufactured from solid tube with a mechanical connection at each end, that connects two high-pressure systems. Pigtails are semi flexible and usually form part of a fixed installation. Pigtails are also used in applications where a flexible hose is unsuitable, for example in applications using corrosive gases, or the permanent installation of gas cylinders, for example, bundles of cylinders.



Figure 2 Pigtails used for an installation of bundles of cylinders

4.4 Articulated / swivel joints

Articulated joints are where a length of pipe is articulated about a union and the pipe takes the place of the flexible hose. These types of connections are used where frequent “making and breaking” of the connection takes place and when a flexible hose is not suitable. Swivel joints are also used to avoid torsion.



Figure 3 Swivel joint

5 Failures of flexible connections

Before designing any high pressure flexible connection, it is important to consider the various modes of failure that can affect a flexible connection as by designing out any weaknesses, it will inevitably lead to better in-service performance of the connection.

The flexible connection has in many cases been the weak link of a pressure system, and it is important to consider this at the design stage. The integrity of the connection is not the only cause for failures that can also be attributed to a design fault in the distribution system or in the use of the flexible connection.

Flexible connection failures can be grouped into two types:

- Mechanical failures; and
- Hose ignitions.

Linked to this the following have been identified as significant factors in connection failures;

- Poor design and/or manufacture;
- Material compatibility;
- Contamination;
- Rapid pressurisation, (adiabatic compression) and depressurisation;
- Particles; and
- Misuse, damage and poor maintenance.

These are considered in more detail.

5.1 Poor design and/or manufacture

Typical faults are:

- Incorrect design pressure where the flexible connection is used beyond the design parameters of the connection.
- Incorrect design, including incorrect design of end fittings and poor attachment of end connections. This can be due to a number of factors such as incorrect specification or an uncontrolled deviation in the process conditions.
- Manufacturing defects, where the flexible connection is not constructed to the manufacturing specification.
- Inadequate material, this can include defective materials or material with inadequate properties, for example strength, toughness.

5.2 Material compatibility

Material compatibility is vital to ensure that a flexible connection will perform safely in service. There are numerous publications on the subject of compatibility, see EN ISO 11114 -1, *Gas cylinders - Compatibility of cylinder and valve materials with gas contents --: Metallic materials* and EN ISO 11114-2, *Gas cylinders - Compatibility of cylinder and valve materials with gas contents --: Non-metallic materials*. [5, 6].

Flexible connections incorporating non-metallic materials such as PCTFE, nylon, neoprene and nitrile liners are available for gas service, but they shall be compatible for use with the gas service.

For oxygen service the auto ignition temperature (AIT) is an important criteria to take into account. The AIT of most common plastics is too low. Even though PTFE has one of the highest auto ignition temperatures in oxygen other criteria need to be taken into account for oxygen service. PTFE does have suitable mechanical properties as a hose liner.

Table 1 Auto ignition temperatures of some common plastic/elastomeric materials in oxygen at 130 bar

Material	Auto ignition temperature °C
PTFE	450-500
PCTFE	400-430
Polyamide(Nylon)	200-230
Nitrile Rubber	170-250
Neoprene	170-200

No non-metallic material should be used for oxygen service unless it has been thoroughly evaluated in both laboratory and field trials. In addition, for medical and breathing applications PTFE and other halogenated non-metallic materials shall not be used for customer installations due to the risk of generating toxic gases, see EIGA Doc 73, Non-metallic materials in high pressure oxygen breathing gas applications and EN ISO 15001, *Anaesthetic and respiratory equipment. Compatibility with oxygen* [7, 8].

PTFE has a high permeability to certain gases for example helium, hydrogen and hydrogen chloride and this has to be taken into account when using these gases. Furthermore, it has to be considered that the plastic materials have relatively low electrical conductivity and that static build up in a hose liner could produce pinhole leaks by static discharge through the liner, see *Electrostatic effects of solid particles in high pressure gas flow in flexible plastic hoses* [9].

5.3 Contamination

Contamination, particularly with oils and greases, is a well-known cause for oxygen hose ignition. Hydrocarbon oils and greases have low auto ignition temperatures in oxygen, for example AIT = 150-200 °C. In high-pressure oxygen atmospheres these oils and greases ignite with explosive force and if they are in contact with a PTFE hose liner they could initiate a fire in the hose.

Even hoses with metal liners can be set on fire by the ignition of a contaminant in the hose. However, the amount of contaminant needed would be several orders of magnitude greater than that necessary to cause ignition of a PTFE liner

5.4 Rapid pressurisation, (adiabatic compression) and depressurisation

A rapid pressurisation, for example a pressure shock resulting from sudden opening of valves can lead to mechanical damage to hose and couplings as well as ignitions in the case of hoses transmitting oxygen or air.

The vast majority of PTFE lined hose ignitions have occurred at customer installations shortly after the cylinder valve has been opened. Damage to the hose has been reported in some instances as a small hole at the dead end, but in other reports the hose has ignited at the other end or at positions between the two ends. In some instances, the hose has ignited at several locations and damage is extensive. A red glow has been observed just before the hose ignited.

Where the hose ignited at the dead end adiabatic compression was attributed as the cause. Particle impingement was assumed as the mechanism where ignition occurred at a distance from the dead end. See also 5.5.1.

The reported ignitions usually followed the sequence of events described below (see Figure 4)

- 1) Valve on cylinder No.1 opened
- 2) Non return valves 2 and 3 closed.
- 3) Valve on cylinder No.2 opened.
- 4) Hose attached to cylinder No. 2 ignites. The hose sometimes glows red before the ignition.

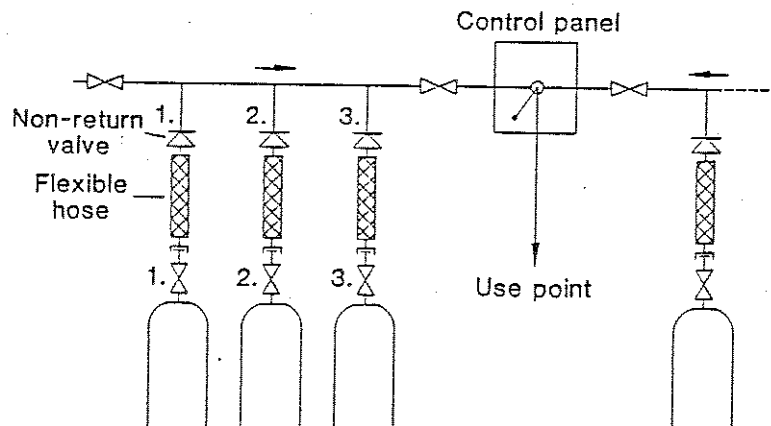


Figure 4 Manifold layout

The mechanism by which ignition could propagate in a PTFE hose was not well understood. Several EIGA member companies initiated research programmes to investigate the ignition process. The results of one such programme are reported in [10].

Under laboratory conditions PTFE lined hoses were subjected to pressure surges of between 240 and 260 bar via a quick opening valve. Hoses were observed to ignite not only at the dead end but also at the opposite end and at intermediate positions in between. In some cases, a red glow which started at the dead end moved slowly along the hose to the opposite end. Ignition in some cases was delayed by up to one minute after the original pressure surge.

These tests indicated that the majority of hose ignitions occurring at customer installations were caused by adiabatic compression and not by particle impingement as had previously been assumed.

Rapid depressurisation can result in high oxygen velocities which coupled with any residual contamination or particles will also result in ignitions.

5.5 Particles

Apart from the possible mechanical damage that can be caused by particles, the main risk is ignition in oxygen service. With particles there are two mechanisms that can cause ignition. These are impingement and static electricity builds up.

5.5.1 Particle impingement

Particle impingement is a known source of ignition in oxygen steel pipelines. As the particles flow along the pipe they make contact with the metal surfaces and are heated by friction. On impact the heat generated can ignite the metal. This mechanism has been put forward as the cause of PTFE lined hose ignitions. However, as PTFE is a soft material and has a very low coefficient of friction and hoses have relatively short lengths this mechanism is less likely to occur. This phenomenon is more likely in metallic flexible connections, for example pigtailed and articulated joints.

5.5.2 Static electricity

Particles in the gas stream are the major cause for the build-up of static electricity inside plastic hoses. Although this mechanism has often been assumed as the cause of hose ignitions, it has never been substantiated for oxygen, though it is strongly suspected when incidents have occurred with flammable gases, see 5.4 and *Ignition of PTFE hoses in high pressure oxygen systems: Test Results and considerations for safe design and use* [9].

5.6 Misuse, damage and poor maintenance

There are a number of causes for misuse of and damage to flexible connections. These include, stretching, kinking, rough handling, mechanical impact, fatigue, abrasion, corrosive atmospheres, accidental exposure to fire and heat. All can damage the flexible hose and subsequently lead to failure.

An appropriate maintenance regime compatible with the intended service needs to be established and documented. This shall include regular exchange of parts regardless of their service worthiness.

6 Recommendations for the prevention of failures of flexible connections

In Section 5, the main causes for hose failures and their mechanisms have been described. This section gives recommendations to avoid such failures.

6.1 Design specification and manufacturing control

Since the original publication of this document, work on the design of flexible hoses has been carried out at the International Standards level. This work has resulted in a number of standards being published. Where applicable these standards should be the basis of any manufacturing specification for a flexible connection.

The design and quality of the finished hose are of paramount importance to the service life of the hose and its satisfactory operation in service.

Before any flexible connection is specified, there shall be a complete understanding of the conditions under which it is going to be used.

A design specification should include:

- The applicable standard (s) of the construction of the flexible connection;
- Intended gas service;
- Internal diameter of the flexible connection;
- Maximum working pressure;
- Operating temperature range;
- Minimum number of pressure cycles over the expected life of the hose, at working pressure;
- Minimum bursting pressure (typically 3 to 4 times the working pressure, except for acetylene hoses where a much higher value applies, more than 35 times the working pressure);
- Material specification;
- Minimum bend radius;
- Hose restraining wire;
- Distance pieces (see Appendix 3);
- Length; and
- Markings.

It should be noted that an increased bore and increased number of braids will result in a greater bending radius.

A new design of hose should undergo type approval tests that can include the following:

- Adiabatic compression test (See Appendix 1);
- Burst pressure test;
- Pressure cycle test;
- Hydraulic pressure test (permanent deformation check);
- Pneumatic leak test (including permeability measuring);
- Impact test for end fittings;
- Bend radius test;
- Integrity of restraining wire arrangement; and
- Material compatibility test, see 6.2.

Quality assurance inspections can include:

- Hydraulic pressure test, typically 1.5 times maximum working pressure;
- Pneumatic leak test at normal working pressure;
- Cleanliness check, see 6.3; and
- Visual inspection especially of the end fittings.

Some of the type approval tests may be carried out on representative samples from each batch.

The requirements are different for an articulated joint as it is a collection of mechanical components where the need is to consider the mechanical stresses of the design.

In addition, there will be a need to consider material of any elastomers used for sealing.

For solid pigtailed hoses, these should be designed in accordance with a recognised piping code. Particular attention needs to be paid to the design to ensure that bend radii are sufficient such that the pipe thickness is not reduced excessively with bending.

Solid pigtailed hoses can be required to undergo pressure testing that complies with the design code used. Certain pigtailed hoses, for example, using copper based alloys, can be required to be annealed in cases where excessive cold work has been introduced.

Additionally, the attachment of end fittings shall ensure that mechanical integrity is achieved.

6.1.1 Restraining wires / safety cable (personnel protection)

The use of a restraining wire or a similar solution is recommended for pressures above 40 bar, see ISO 14113 [3] as they have been proven to prevent hoses from flailing around in the event of a failure and significantly reducing the risk of injury. Other solutions, for example a protective cage, assume the hose will flail, but provide personnel protection.

The restraining wire should be securely fastened at each end to prevent the hose from flailing in the case of a fitting failure.

To check the efficiency of the restraining wire, see the requirement of ISO 16964 [3].

Some hoses are provided with an internal cable to prevent injury in the case of a failure.

An internal restraining wire should only be used when it is certain that the wire will be compatible with the gas being carried through the hose, particularly oxygen. It should be ensured that any manufacturing process does not leave contaminants on the wire, which could react with the gas. Additionally, a check should be carried out that the wire does not restrict flow.

6.2 Material compatibility

Checks shall always be made to ensure that the materials used for the construction of flexible hoses are compatible for use with the gas at the service temperature and pressure.

There are a number of documents and standards to assist in the verification of material compatibility e.g. EN ISO 11114-1, EN ISO 11114-2 and EN ISO 11114-4, *Transportable gas cylinders. Compatibility of cylinder and valve materials with gas contents. Test methods for selecting metallic materials resistant to hydrogen embrittlement.* [5, 6, 11]

6.2.1 Hoses incorporating a plastic liner

For oxygen service, PTFE lined hoses are used, see 4.2, whereas for hydrogen, helium and toxic gases service a material less permeable than PTFE should be considered.

6.2.2 Hoses incorporating a metallic liner

The main concern of metallic lined hoses is to confirm the compatibility of some stainless steels with hydrogen and other embrittling gases, see EN ISO 11114-1 and EN ISO 11114-4, [5, 11].

6.3 Cleanliness

Regardless of gas service, flexible hoses shall be cleaned to remove traces of oil, grease, combustible materials and particles. Particular attention shall be paid to hoses in oxidising gas service.

This cleaning is normally conducted by flushing out the hose with a clean compatible solvent with ultrasonic assistance to remove contaminants. This operation is normally conducted under the manufacturers' specification and the hoses then suitably packed, for example sealed into clean plastic bags, for shipment to the point of use. This is carried out to ensure that contaminants cannot enter the hose after it has been cleaned.

Specific measures shall be taken for:

- Corrugated hoses to ensure removal of all traces of solvent; and
- Plastic and PTFE lined hose to ensure that a compatible solvent is used.

The hose supplier should carry out quality assurance checks.

To confirm that the cleaning procedure used by the manufacturer is adequate, a sample of each batch of hose should be checked for contamination. For oxidising gas service, the hydrocarbon contamination level shall be consistent with the pressure and oxygen content concerned and the values should be in the range of 100 to 500 mg/m². For more information, see EIGA Doc 33, *Cleaning of equipment for oxygen service – Guidelines* [12].

6.4 Rapid pressurisation (Adiabatic compression)

In principle, rapid pressurisation should be avoided to prevent adiabatic compression. Where prevention is difficult, and rapid pressurisation leads to a temperature increase at the dead ends, see 5.4, a number of precautions should be taken when using plastic lined hoses, for example customer manifolds with non-return valves, see Figure 4.

Where such effects can occur in oxidising or compressed air service, the following solutions are recommended to avoid ignition:

- Use of metallic pigtails, corrugated metal hose, articulated joints; and
- Use of distance pieces (see Appendix 3) fitted to PTFE lined hoses.

It is recognised that the quantity of gas compressed is an important criterion in hose ignitions. Shorter hoses, typically less than 1 m, are more difficult to ignite than longer hoses because of this fact.

The distance piece (heat sink) should be fitted to the dead end. This is normally the downstream end of the hose. These distance pieces may also be fitted to both ends of any hose so that the ends can be interchanged. The distance piece absorbs the heat from any hot gas produced by compression and prevents the contact of the hot gas with the hose liner.

Experiments [10] have shown that copper distance pieces are more effective in preventing ignitions from adiabatic compression effects than brass or stainless steel. The thermal conductivity of the material appears to be a significant factor in the effectiveness of the distance piece.

A method of calculating the effective length of a distance piece is given by ASTM *Design Strategies for polymer lined flex-hose Distance/ Volume pieces* [13] Experiments have shown that a 150 mm length of copper pipe or a 250 mm length of stainless steel pipe is sufficient to prevent ignitions in a one metre length of hose used for filling or emptying a single gas cylinder at an oxygen pressures up to 240 bar. For bundle hoses longer distance pieces may be required.

Distance pieces are intended to prevent ignition of a PTFE liner by preventing temperatures exceeding 450°C. However, above 300°C PTFE can decompose with the formation of toxic vapours. Consequently, the use of distance pieces will require to be validated taking into account the toxicity risk for medical applications, see EIGA Doc 73 [7] and 4.2

Where hoses fitted with distance pieces are used for gases other than oxygen and air, the compatibility of the gas with the material of the distance piece has to be checked, for example no copper for acetylene service, see EN ISO 11114-1[5].

The distance piece can be straight or bent depending on the configuration of the system, see Appendix 3.

6.5 Particles

It is good practice to prevent ingress of particles into any gas equipment, but particularly equipment for oxygen service.

To prevent particles being entrained in gas streams, the following have been used within the gases industry:

- Appropriate cleaning procedures;
- Dust caps over the cylinder valves during transport;
- Filters in the line at the point of cylinder connection, though these do need frequent maintenance; and
- In the case of oxygen and compressed air, advising customers to clean the outlet of the valve before connection.

Before connecting a cylinder to a manifold system the user should visibly check that the valve is clean and free from obvious signs of contamination.

6.6 Static electricity

This only applies to plastic lined hoses, see 5.5.2. One method of reducing the risk of static build up in this type of hose is to use an anti-static liner, for example a carbon loaded PTFE liner.

Another method is to eliminate particles from the gas stream since they are primarily responsible for producing static charges.

As noted previously there is no evidence that any ignitions inside plastic lined hoses have been caused by this mechanism.

To prevent the formation of pinholes the use of an anti-static liner may be beneficial, see 4.2.

The electrical conductivity of a hose should be in accordance with EN ISO 14113 [1].

6.7 Operation, use and maintenance

Before hoses are fitted and used it is essential to ensure that all relevant service conditions have been considered in the hose specification, see 5.1 to 5.6.

The optimum length of the hoses should be selected for each application to prevent undue torsion stresses on the hose. Where torsion stresses cannot be avoided, the use of swivel joints should be considered.

Hoses should be maintained in good mechanical condition and should be regularly inspected for damage or deterioration.

Where hoses are subjected to rough handling, mechanical impact or abrasion some form of protective covering should be fitted.

As deterioration of hoses can lead to failures, hoses should be included in the maintenance programme for the facility. Part of this will require the replacement at regular intervals as determined by the user and the operating conditions, including, but not limited to frequency of filling, hose dimensions and environmental conditions.

For filling stations, hoses should be visually inspected prior to each day of use.

7 Check list

The checklist in Appendix 2 has been prepared to assist designers in checking the design of an oxygen installation incorporating PTFE hoses.

8 References

Unless otherwise specified, the latest edition shall apply.

- [1] IGC 42, *Prevention of Hose Failures in High Pressure Gas Systems (1989)* www.eiga.eu

NOTE: This document has been withdrawn but is available from EIGA

- [2] EN ISO 14113, *Gas welding equipment. Rubber and plastics hose and hose assemblies for use with industrial gases up to 450 bar (45 MPa)* www.cen.eu

- [3] ISO 16964, *Gas cylinders - Flexible hose assemblies - Specification and testing* www.iso.org

- [4] EN 12434 *Cryogenic vessels. Cryogenic flexible hoses* www.cen.eu

- [5] EN ISO 11114-1, *Gas cylinders -- Compatibility of cylinder and valve materials with gas contents -- Metallic materials* www.cen.eu

-
- [6] EN ISO 11114-2, *Gas cylinders -- Compatibility of cylinder and valve materials with gas contents -- Non-metallic materials* www.cen.eu
- [7] EIGA Doc 73, *Non-metallic materials in high pressure oxygen breathing gas applications* www.euga.eu
- [8] EN ISO 15001, *Anaesthetic and respiratory equipment. Compatibility with oxygen* www.cen.eu
- [9] Anna Norberg "Electrostatic effects of solid particles in high pressure gas flow in flexible plastic hoses" Institute of High Voltage Research, Uppsala 1987
- [10]. H Barthélémy, and G Vagnard, *Ignition of PTFE hoses in high pressure oxygen systems: Test Results and considerations for safe design and use. Paper presented at ASTM Symposium on Flammability and sensitivity of Materials in Oxygen Enriched Atmospheres* 1987 ASTM STP 986 www.astm.org
- [11] EN ISO 11114-4, *Transportable gas cylinders. Compatibility of cylinder and valve materials with gas contents. Test methods for selecting metallic materials resistant to hydrogen embrittlement.* www.cen.eu
- [12] EIGA Doc 33, *Cleaning of equipment for oxygen service – Guidelines* www.eiga.eu
- [13] A.J.Santay, I.D.Becker and B.L.Werley. "Design Strategies for polymer lined flex-hose Distance/ Volume pieces "Paper presented at ASTM Symposium on "Flammability and sensitivity of Materials in Oxygen Enriched Atmospheres" 1997 ASTM STP 1319 www.astm.org

Appendix 1 - Adiabatic compression

When a gas is compressed rapidly it increases in temperature. The theoretical final temperature when oxygen is compressed assuming the process is adiabatic, (no heat loss to the surroundings), is calculated from the following equation:

$$T_2 = T_1 \times (P_2/P_1)^{(\gamma-1)/\gamma}$$

Where	T ₁	=	Initial gas temperature (K)
	T ₂	=	Final gas temperature (K)
	P ₁	=	Initial gas pressure (bar a)
	P ₂	=	Final gas Pressure (bar a)
	γ	=	Ratio of heat capacities, (1.4 for oxygen)

Therefore, if oxygen is compressed from 1 bar to 200 bar at 15°C, the adiabatic theoretical temperature would be 1036°C. Fortunately these theoretical temperatures are never reached in practice, due to heat losses to the surroundings, but the temperatures generated are above the ignition temperature of PTFE at pressure ratios normally encountered in high pressure systems.


Reference should be made to the ASTM Paper; *Design Strategies for Polymer lined flex hose Distance/Volume pieces*, [13].

Appendix 2 - Check list

This checklist can be used when designing and supplying systems incorporating PTFE lined hoses.

1. Have all the materials been approved in the system for the particular oxygen service conditions, for example, temperature and pressure?
 - a) Non-metallic materials, for example elastomers, plastics, valve seats and seals.
 - b) Metallic materials.
2. Has the system been cleaned to the appropriate standard and can the system be easily cleaned once it has been installed?
3. Have the following been considered to the possibility of adiabatic compression occurring: -
 - a) Are there any dead ends in the system?
 - b) Have any fast opening valves been installed in the system, for example ball valves, quick action globe valves or automatic valves?
 - c) Can the equipment resist adiabatic compression, for example hoses, valves, pipe work, gauges?
 - d) Are there procedures to specify the sequence for opening valves?
4. Can the system tolerate particles?
5. Has the build-up of static electricity been considered and has it been eliminated?
6. Has sufficient care been taken to ensure that mechanical damage to the hoses can be reduced to a minimum? Have the following been considered?
 - a) Can the hose be damaged by impact?
 - b) Are the hoses of optimum length and diameter for the particular application?
7. Has sufficient information been supplied to person who is to operate the equipment to enable them to operate it in a safe manner?

Appendix 3 - Example of a hose with a bent and straight distance piece

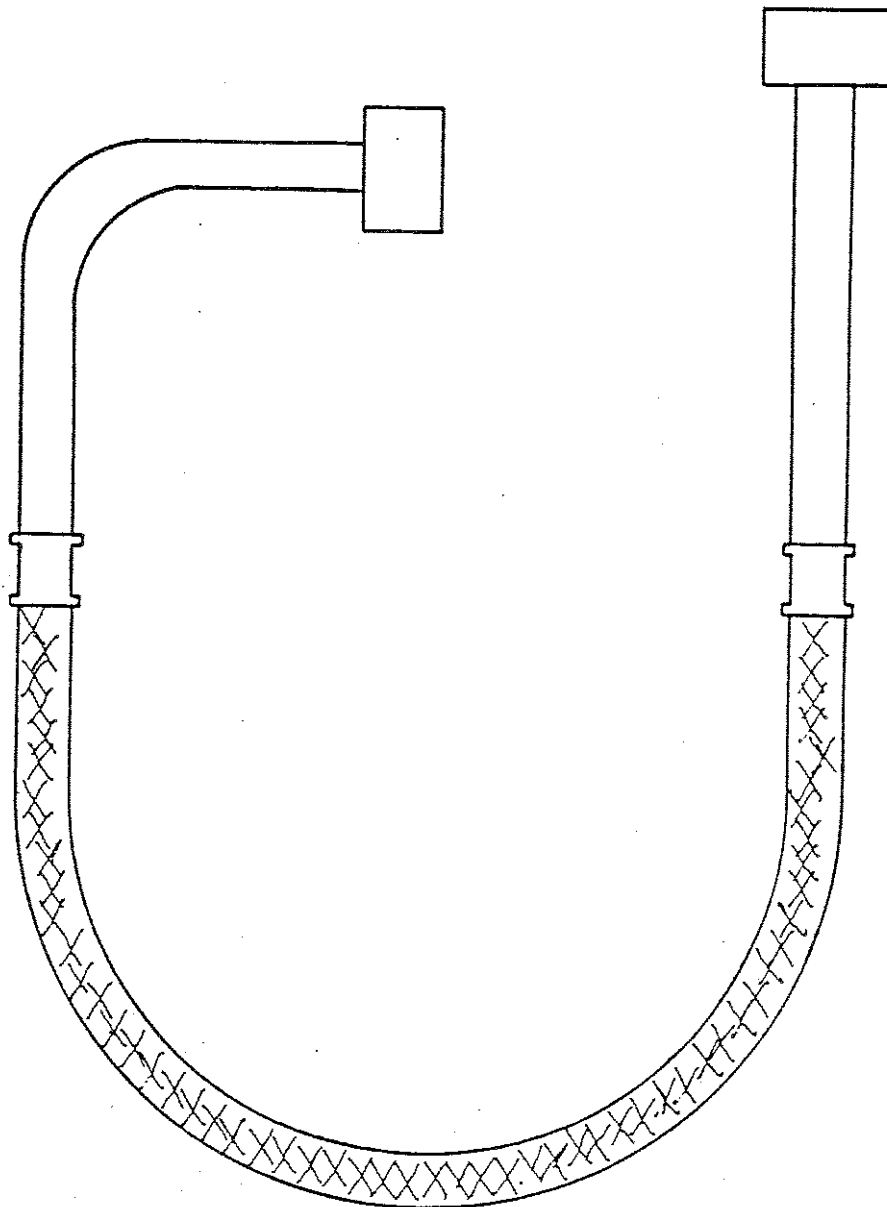

NOTE Any additional connection parts can act in similar way as distance pieces, (absorbing heat) for example, quick connection handles, hose ends.